

Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene)



Reporting Period: 1 January 2025 - 31 March 2025

Emergency Structure Fires meeting benchmark by Station Maintenance Area

Primarily residential structure fires including commercial centres, industrial and/or community services e.g. schools, facilities, hospitals. FRV has service delivery standards, which specify a response time target for a station to attend an emergency incident. The service delivery standard (response time) for Structure Fire is 7.7 minutes.

Legend 90%+ 80%-89% 70%-79% 60%-69% 50%-59% <50%


% within benchmark

FRV District + Station Maintenance Area	Number of incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents the standards were met by any station	% of emergency incidents the standards were met by any station	The time in minutes in which 90% of emergency incidents were responded to by any station
Central District	222	219	212	96.8%	6.6
1 - Eastern Hill	22	20	19	95.0%	5.5
2 - West Melbourne	13	13	13	100.0%	5.7
3 - Carlton	20	20	20	100.0%	5.1
4 - Brunswick	20	20	20	100.0%	6.1
10 - Richmond	27	27	27	100.0%	6.0
13 - Northcote	13	13	13	100.0%	6.1
18 - Hawthorn	13	13	13	100.0%	6.5
35 - Windsor	42	41	37	90.2%	7.6
38 - South Melbourne	31	31	30	96.8%	6.0
50 - Ascot Vale	21	21	20	95.2%	7.4
Eastern District	38	38	36	94.7%	6.4
20 - Box Hill	18	18	17	94.4%	6.0
23 - Burwood	10	10	10	100.0%	6.2
28 - Vermont South	10	10	9	90.0%	8.1
North West Region	30	30	30	100.0%	6.4
72 - Mildura	16	16	16	100.0%	6.8
73 - Bendigo	14	14	14	100.0%	6.1
Northern District	129	124	107	86.3%	8.0
5 - Broadmeadows	31	29	23	79.3%	8.5
6 - Pascoe Vale	14	13	11	84.6%	7.9
7 - Thomastown	16	15	13	86.7%	7.8
9 - Somerton	10	10	8	80.0%	7.8
12 - Preston	17	16	14	87.5%	7.7
14 - Bundoora	12	12	11	91.7%	7.0
15 - Heidelberg	16	16	15	93.8%	6.8
80 - Craigieburn	13	13	12	92.3%	7.5
Southern District 1	107	104	92	88.5%	7.9
24 - Glen Iris	25	24	20	83.3%	8.0
31 - Glen Waverley	16	16	14	87.5%	7.5
32 - Ormond	20	20	17	85.0%	8.0
33 - Mentone	10	10	9	90.0%	7.6
34 - Highett	22	21	20	95.2%	6.4
89 - Springvale	14	13	12	92.3%	7.6
Southern District 2	84	82	64	78.0%	9.0
87 - Dandenong	25	25 19	18 15	72.0% 78.9%	8.9 8.3
88 - Hallam	20 15	19	12	85.7%	10.6
91 - Frankston	12	12	9	75.0%	8.4
92 - Cranbourne	12	12	10	83.3%	8.5
94 - Mornington	45	43	38	88.4%	7.7
Western District 1	19	18	17	94.4%	6.3
47 - Footscray	26	25	21	84.0%	8.4
57 - Tarneit	58	57	36	63.2%	9.1
Western District 2	16	16	14	87.5%	7.9
41 - St. Albans	12	12	11	91.7%	7.9
44 - Sunshine	12	12	3	25.0%	10.5
55 - Caroline Springs	18	17	8	47.1%	9.0
56 - Melton	29	29	28	96.6%	7.2
Western District 3	15	15	14	93.3%	7.4
62 - Corio	14	14	14	100.0%	6.6
63 - Geelong City	742	726	643	88.6%	7.9
Total	142	120	043	00.0%	6. 1




Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene)



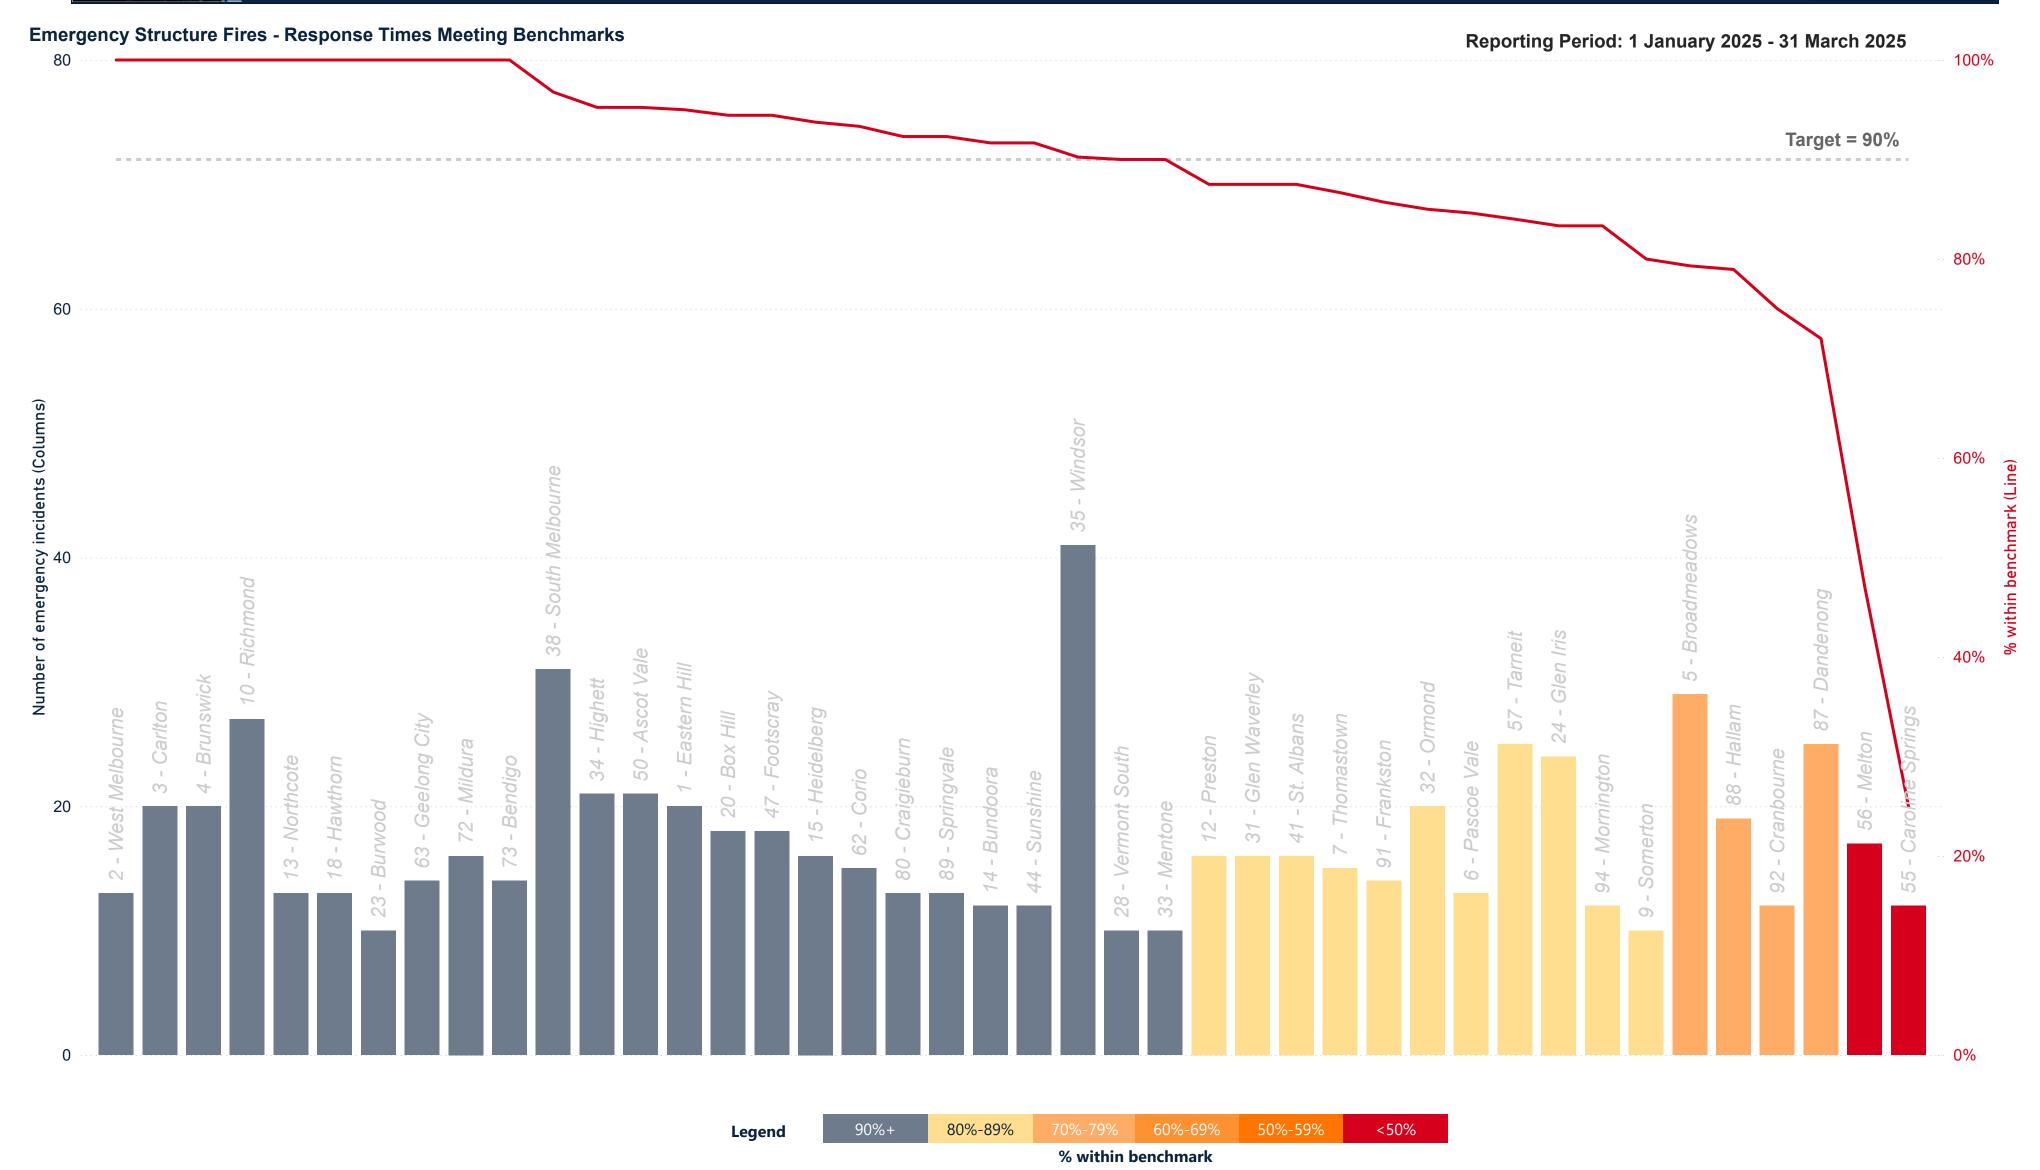



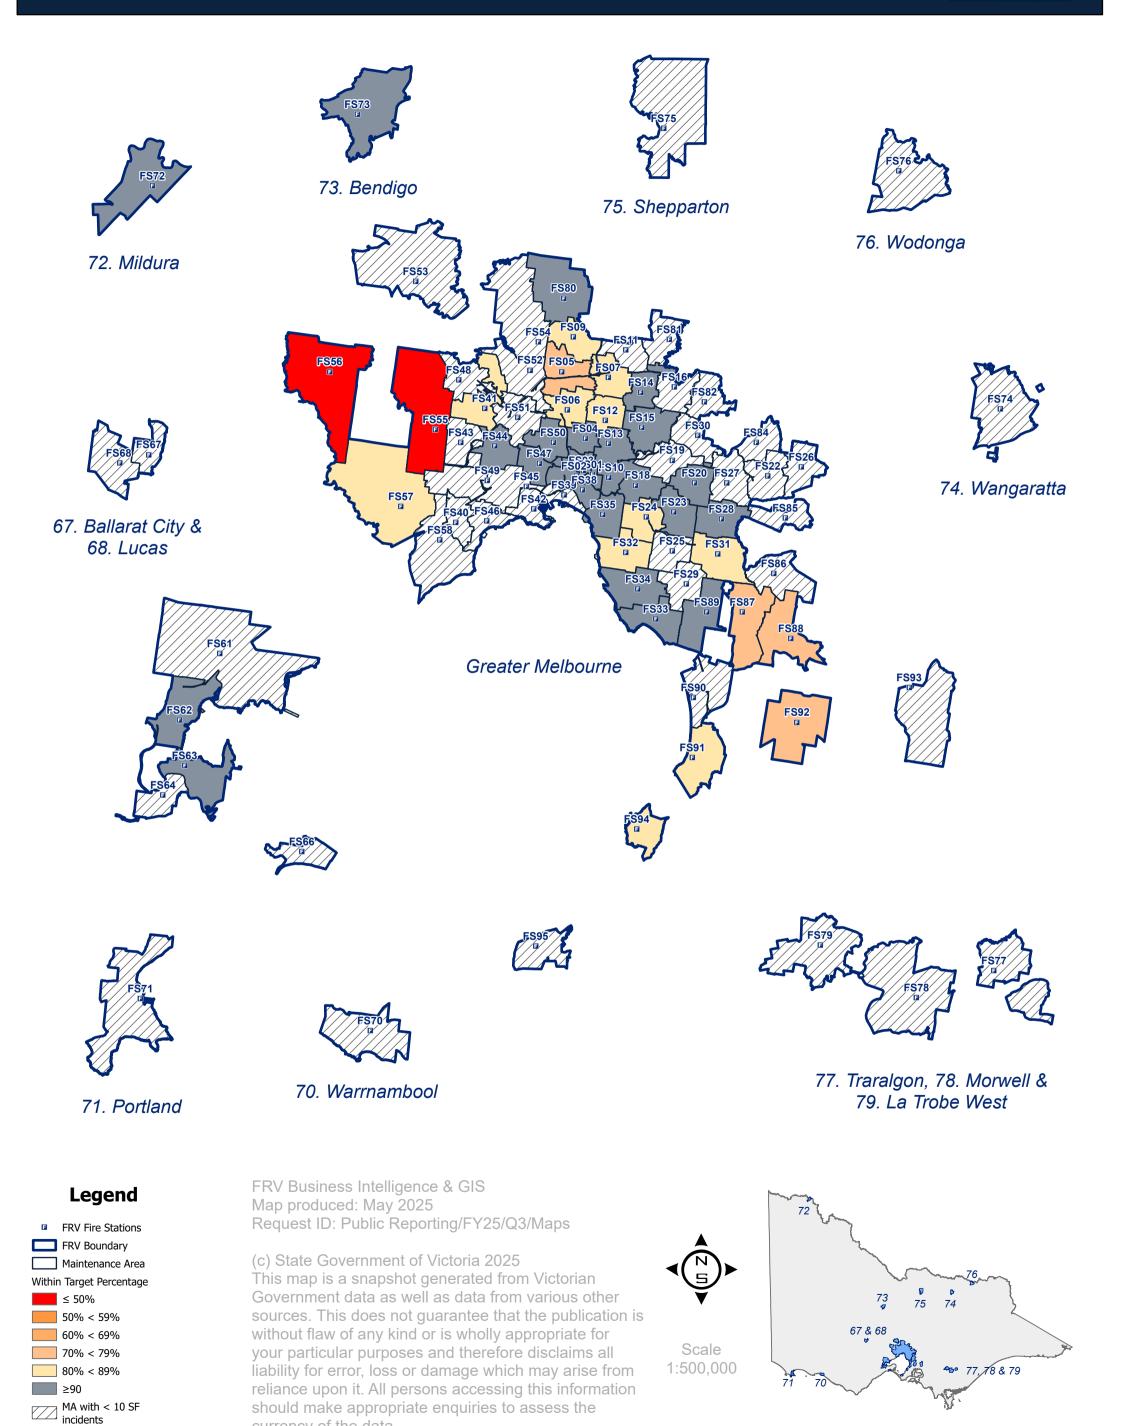

should make appropriate enquiries to assess the

currency of the data.